



ACCESSIBILITY DETAILS FOR RESTROOMS AND DRINKING FOUNTAINS

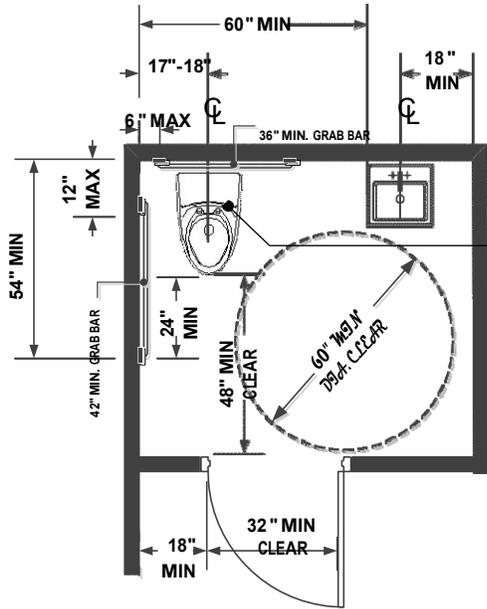

SINGLE-ACCOMMODATION TOILET FACILITY

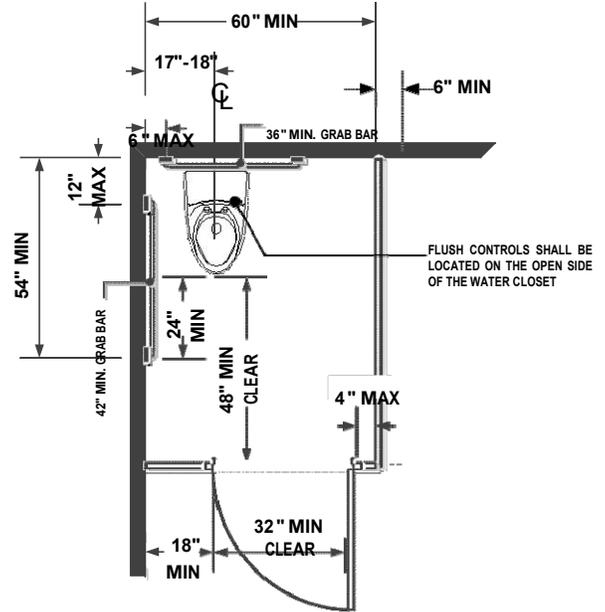

ACCESSIBLE WATER CLOSET COMPARTMENT WITHIN MULTIPLE-ACCOMMODATION TOILET FACILITY

Doors shall not swing into the clear floor space or clearance required for any fixture. Other than the door to the accessible water closet compartment, a door in any position, may encroach into the turning space by 12 inches (305 mm) maximum. (11B-603.2.3)
 Exceptions: (2) Where the toilet room or bathing room is for individual use and a clear floor space complying with Section 11B-305.3 is provided within the room beyond the arc of the door swing, doors shall be permitted to swing into the clear floor space or clearance required for any fixture.

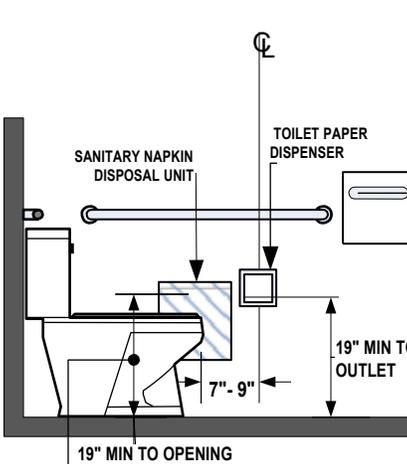


FIGURE 11B-604.7.1 DISPENSER OUTLET LOCATION

FIGURE 11B-604.7.2 DISPOSAL UNIT LOCATION

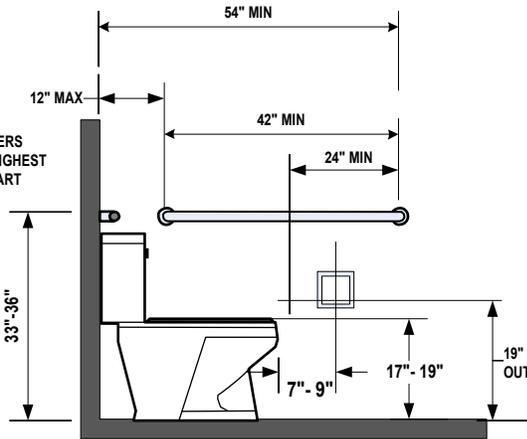


FIGURE 11B-604.5.1 SIDE WALL GRAB BAR AT WATER CLOSETS

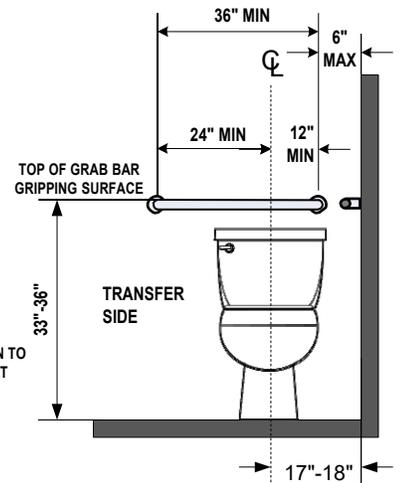


FIGURE 11B-604.5.2 REAR WALL GRAB BAR AT WATER CLOSETS

THESE DIAGRAMS ILLUSTRATE THE SPECIFIC REQUIREMENTS OF THESE REGULATIONS AND ARE INTENDED ONLY AS AN AID FOR BUILDING DESIGN AND CONSTRUCTION.

As a covered entity under Title II of the Americans with Disabilities Act, the City of Los Angeles does not discriminate on the basis of disability and, upon request, will provide reasonable accommodation to ensure equal access to its programs, services and activities.

THESE DIAGRAMS ILLUSTRATE THE SPECIFIC REQUIREMENTS OF THESE REGULATIONS AND ARE INTENDED ONLY AS AN AID FOR BUILDING DESIGN AND CONSTRUCTION.

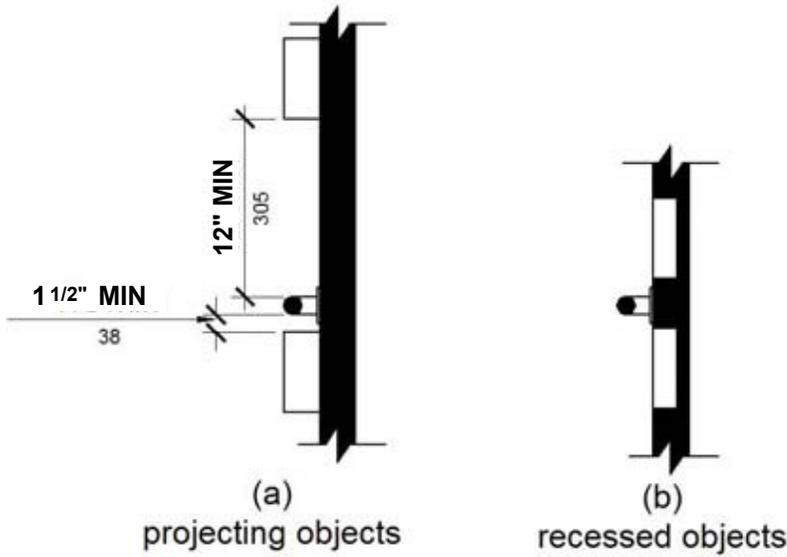


FIGURE 11B-609.3
SPACING OF GRAB BARS

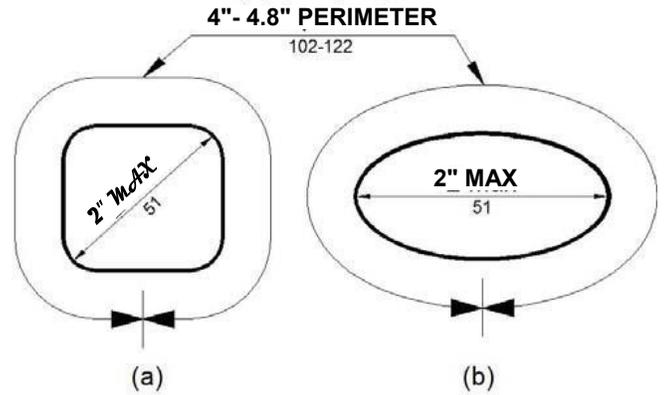


FIGURE 11B-609.2.2
GRAB BAR NON-CIRCULAR CROSS SECTION

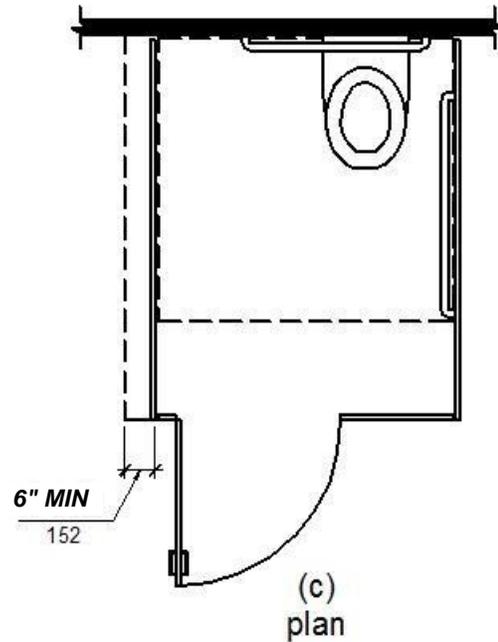
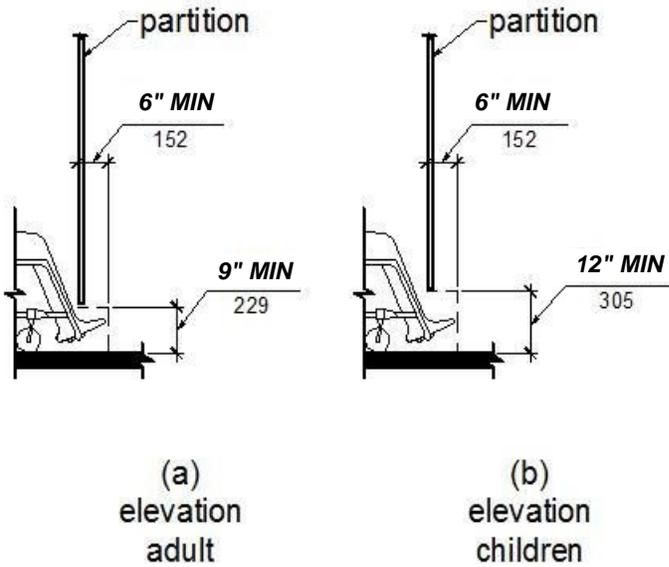


FIGURE 11B-604.8.1.4
WHEELCHAIR ACCESSIBLE TOILET COMPARTMENT TOE CLEARANCE

As a covered entity under Title II of the Americans with Disabilities Act, the City of Los Angeles does not discriminate on the basis of disability and, upon request, will provide reasonable accommodation to ensure equal access to its programs, services and activities.

THESE DIAGRAMS ILLUSTRATE THE SPECIFIC REQUIREMENTS OF THESE REGULATIONS AND ARE INTENDED ONLY AS AN AID FOR BUILDING DESIGN AND CONSTRUCTION.

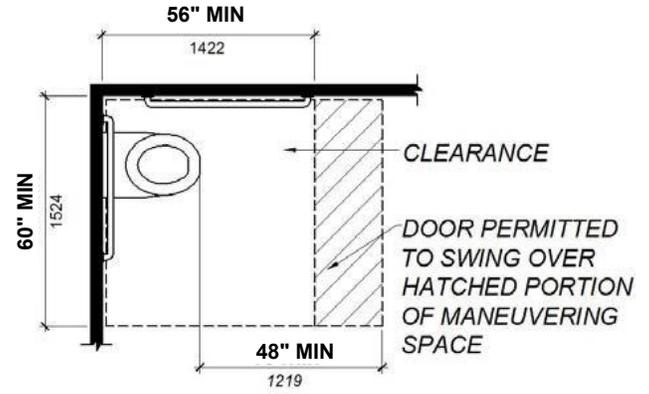
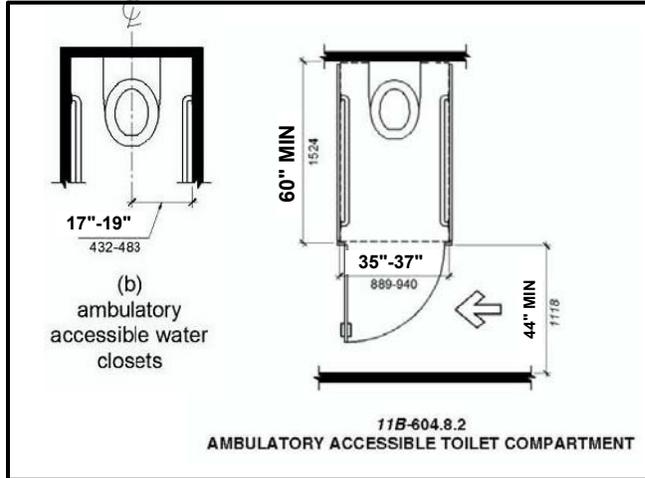


FIGURE 11B-604.3.1 - SIZE OF CLEARANCE AT WATER CLOSETS

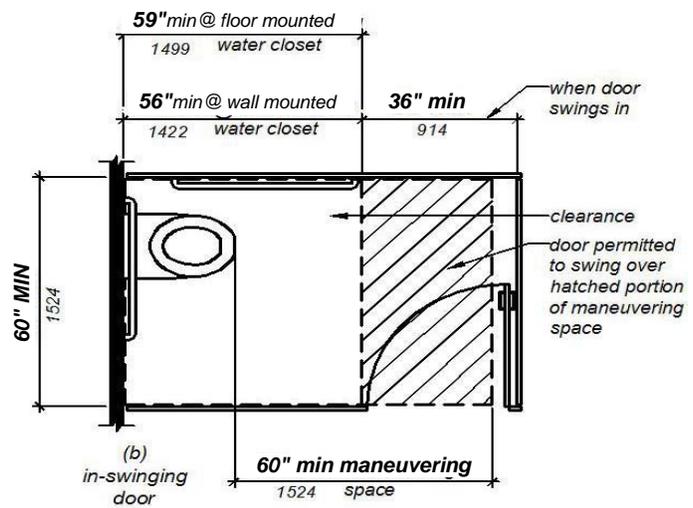
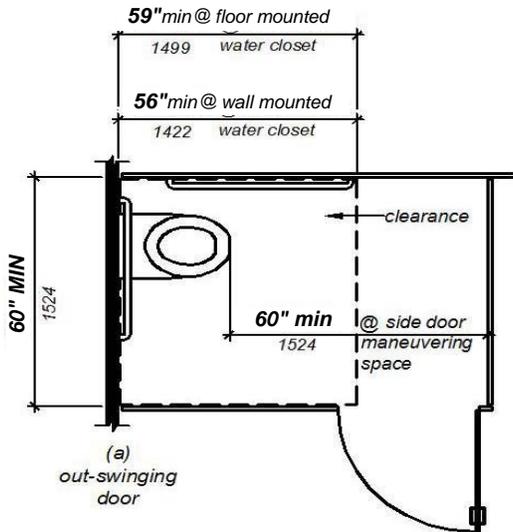


FIGURE 11B-604.8.1.1.2 - MANEUVERING SPACE WITH SIDE-OPENING DOOR

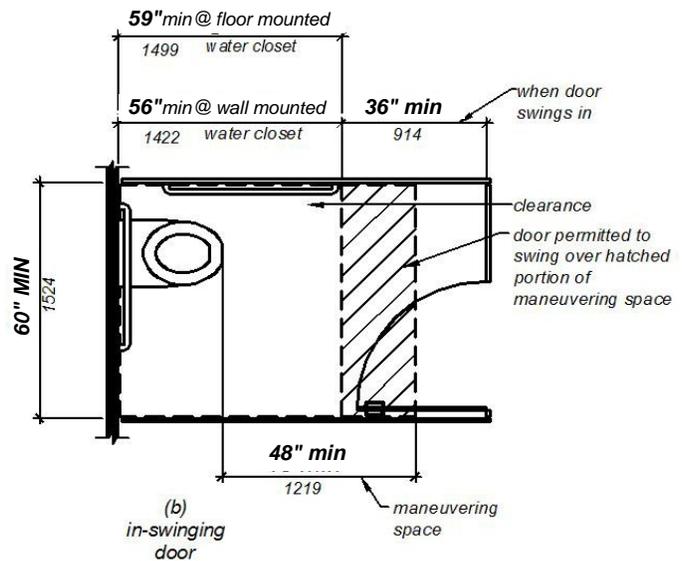
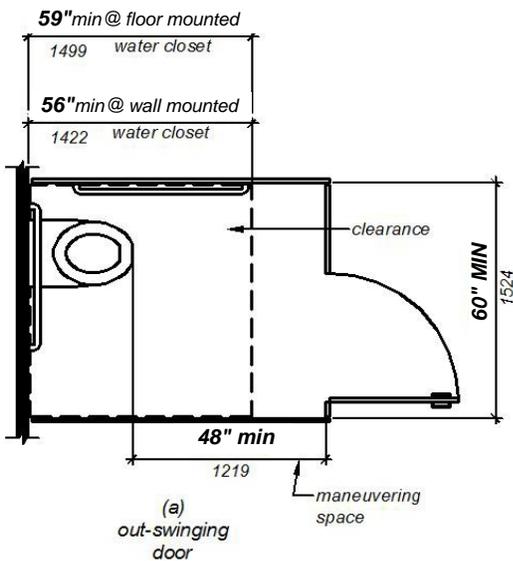


FIGURE 11B-604.8.1.1.3 - MANEUVERING SPACE WITH END-OPENING DOOR

As a covered entity under Title II of the Americans with Disabilities Act, the City of Los Angeles does not discriminate on the basis of disability and, upon request, will provide reasonable accommodation to ensure equal access to its programs, services and activities.

SINK / URINAL

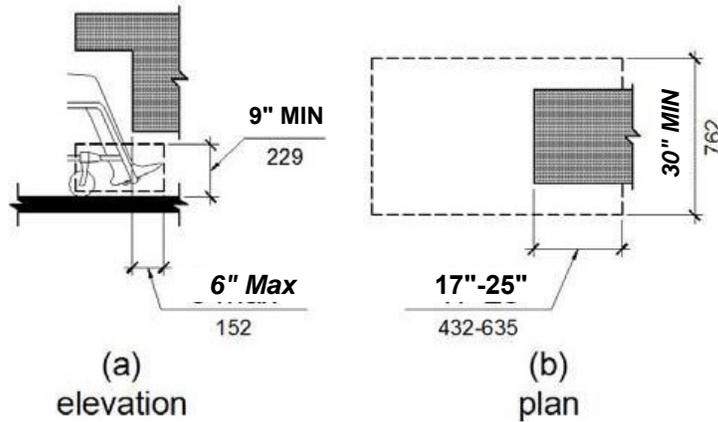


FIGURE 11B-306.2 - TOE CLEARANCE

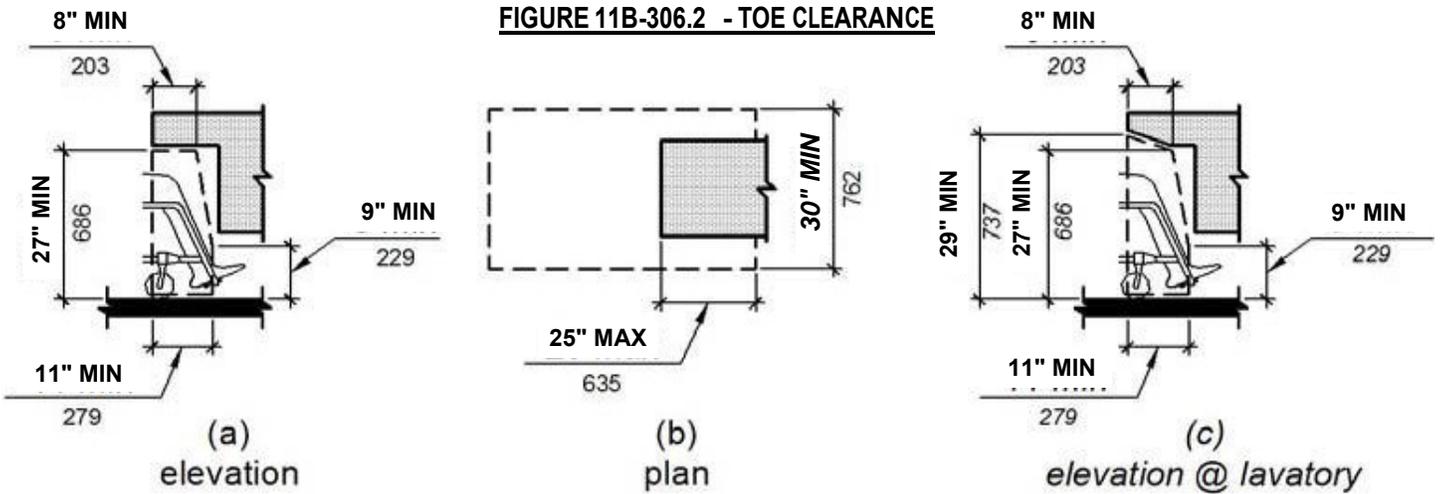


FIGURE 11B-306.3 - KNEE CLEARANCE



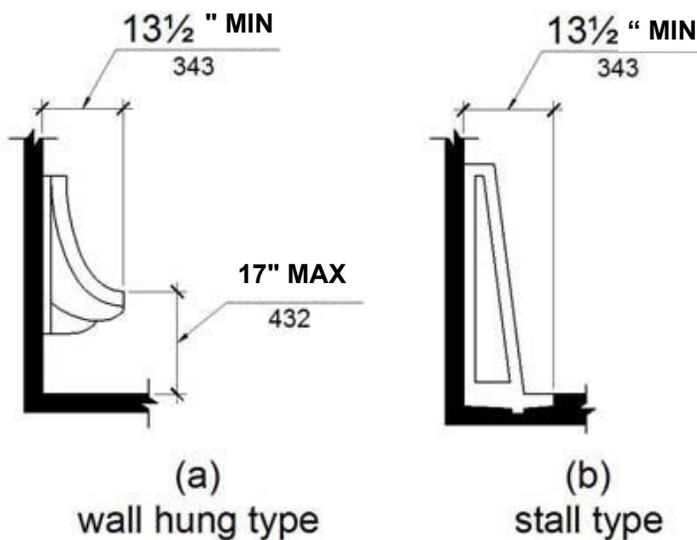


FIGURE 11B-605.2 - HEIGHT AND DEPTH OF URINALS

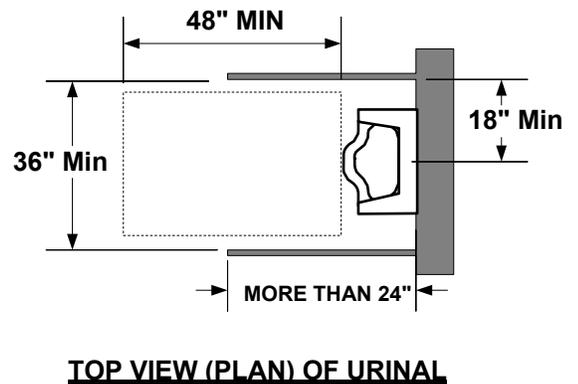

THESE DIAGRAMS ILLUSTRATE THE SPECIFIC REQUIREMENTS OF THESE REGULATIONS AND ARE INTENDED ONLY AS AN AID FOR BUILDING DESIGN AND CONSTRUCTION.

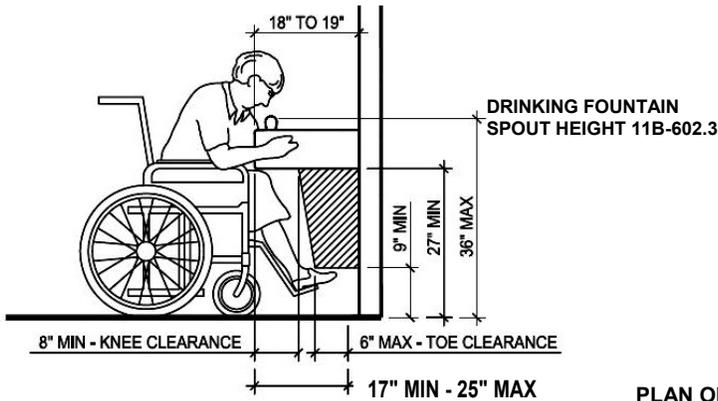

* EQUIPMENT PERMITTED IN SHADED AREA

SEE FIGURE 11B-306.2 "TOE CLEARANCE"
 SPOUT HEIGHT AND KNEE CLEARANCE AT DRINKING FOUNTAINS

PLAN OF "LOW" DRINKING FOUNTAIN



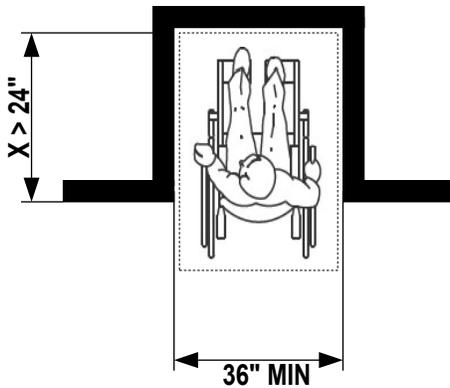


FIGURE 11B-305.7.1
 MANEUVERING CLEARANCE IN AN
 ALCOVE, FORWARD APPROACH

PLAN OF "HI AND LOW" DRINKING FOUNTAIN

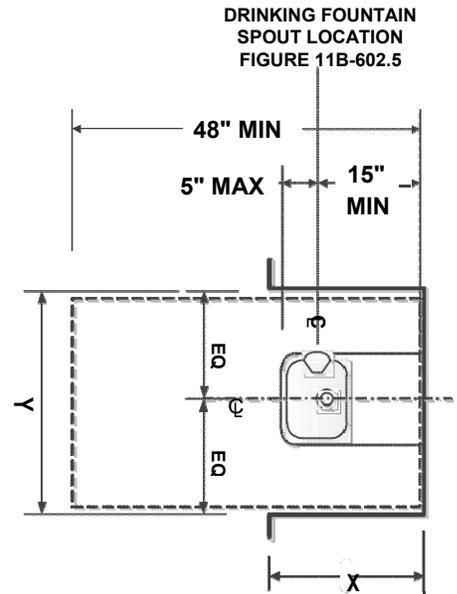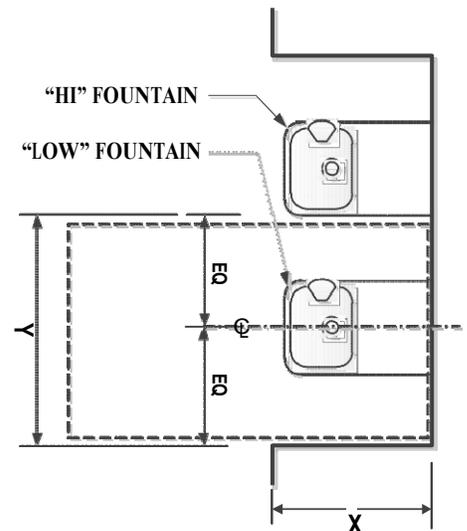

CLEAR FLOOR SPACE AT "HI AND LOW" DRINKING FOUNTAIN WITHIN ALCOVES

NOTE:

IF X = 18" MIN. ALCOVE DEPTH, THEN Y = 32" MIN.
 IF ALCOVE DEPTH (X) IS GREATER THAN 24", THEN ALCOVE WIDTH (Y) MUST BE MINIMUM OF 36" CLEAR.

11B-602.6 Water flow. The spout shall provide a flow of water 4 inches (102 mm) high minimum and shall be located 5 inches (127 mm) maximum from the front of the unit. The angle of the water stream shall be measured horizontally relative to the front face of the unit. Where spouts are located less than 3 inches (76 mm) of the front of the unit, the angle of the water stream shall be 30 degrees maximum. Where spouts are located between 3 inches (76 mm) and 5 inches (127 mm) maximum from the front of the unit, the angle of the water stream shall be 15 degrees maximum.

11B-602.7 Drinking fountains for standing persons. Spout outlets of drinking fountains for standing persons shall be 38 inches (965 mm) minimum and 43 inches (1092 mm) maximum above the finish floor or ground.

11B-602.8 Depth. Wall- and post-mounted cantilevered drinking fountains shall be 18 inches (457 mm) minimum and 19 inches (483 mm) maximum in depth.

11B-602.9 Pedestrian protection. All drinking fountains shall either be located completely within alcoves, positioned completely between wing walls, or otherwise positioned so as not to encroach into pedestrian ways. The protected area within which a drinking fountain is located shall be 32 inches (813 mm) wide minimum and 18 inches (457 mm) deep minimum, and shall comply with Section 11B-305.7. When used, wing walls or barriers shall project horizontally at least as far as the drinking fountain and to within 6 inches (152 mm) vertically from the floor or ground surface.